
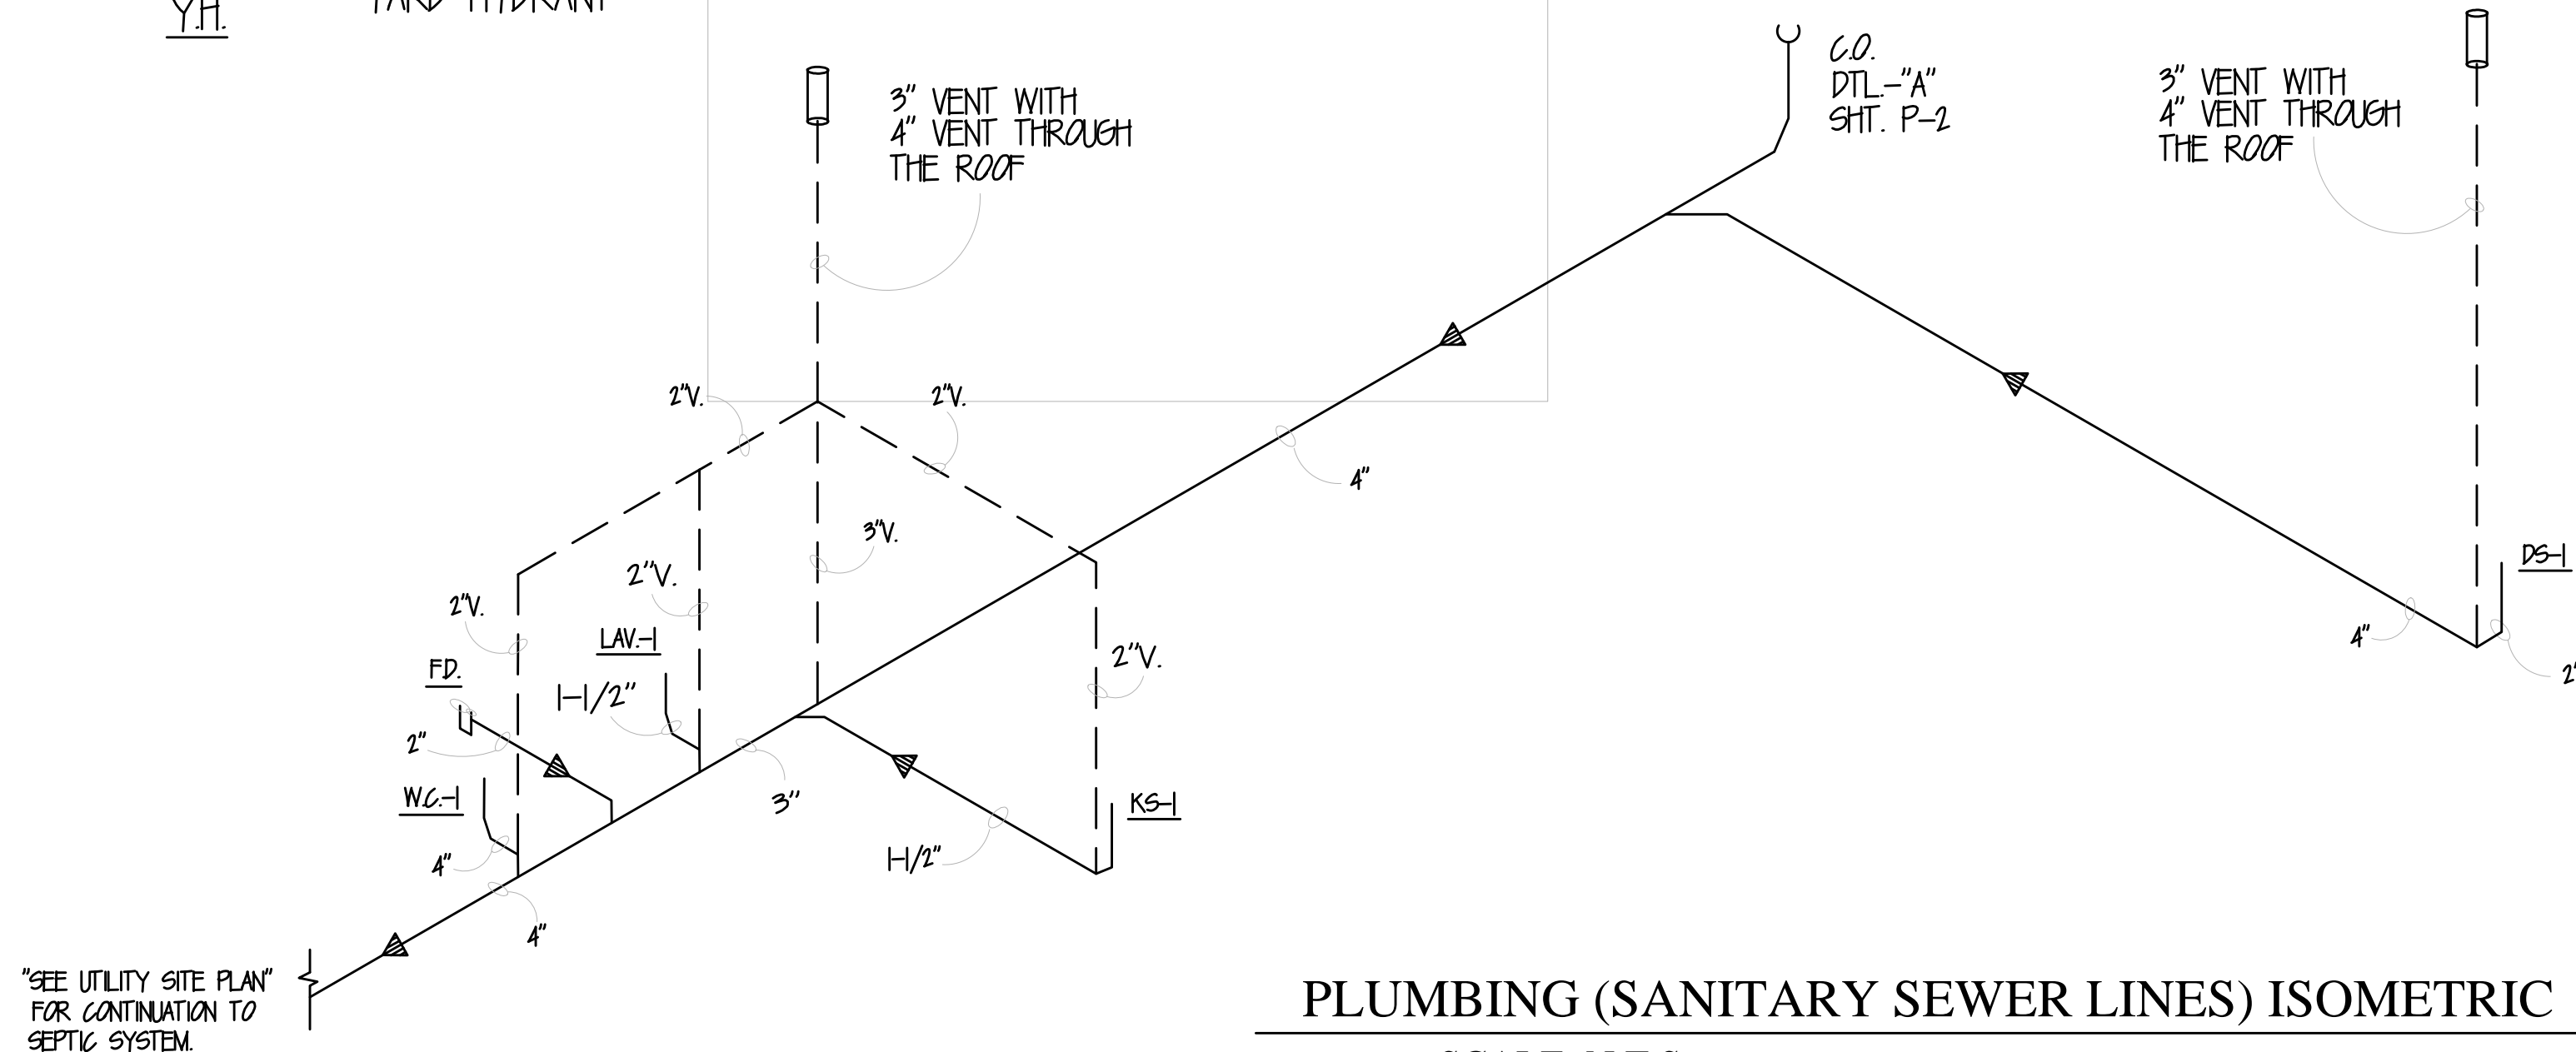


PLUMBING SYMBOLS	
MARK	DESCRIPTION
----	COLD WATER LINE
----	HOT WATER LINE
←	DIRECTION OF FLOW ( VARIOUS LINES )
----	WASTE PIPING
----	VENT PIPING
C.O. ⤵	CLEAN OUT
⋈	SHUT-OFF VALVE
— —	PIPING UNION ( FOR W/H )
— H —	HOSE BIBB
FP. ⤵	FREEZEPROOF
Y.H. ⤵	YARD HYDRANT

### PLUMBING - SANITARY SEWER PLAN

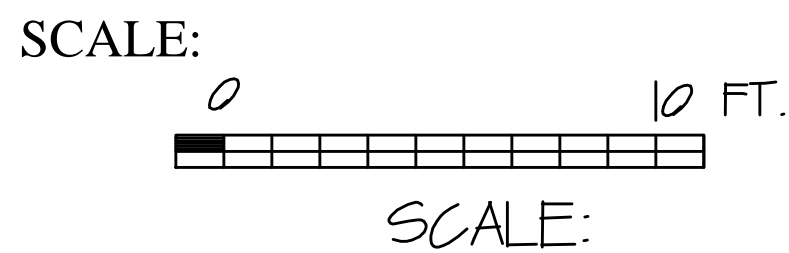

### PLUMBING (SANITARY SEWER LINES) ISOMETRIC

SCALE: N.T.S.


PLUMBING FIXTURE SCHEDULE			
MARK	VENDOR / MOD. NO.	DESCRIPTION	NOTES
W6-1	TOTO / MOD. CSTABACEF-L	WATER CLOSET W/ LEFT HAND LEVER AND OPEN FRONT COMMERCIAL SEAT - 19" AFF. TOP OF SEAT	1.
LAV-1	AMERICAN STANDARD / MOD. OPA01A	RESTROOM LAVATORY	2.
KS-1	ELKAY / MOD. S-4819-L (LEFT HAND)	SINK: SINGLE BOWL W/ SINGLE DRAINBOARD - FITS 48" BASE CABINET	3.
DS-1	CECO / MOD. B45	DEEP SINK - CAST IRON PORCELAIN ENAMELED	5.
WH-1	CHRONAMITE MOD.# SR-40	ELECTRIC WATER HEATER (POINT-OF-USE) - 2P-50 AMP - 3600 WATTS	6.
WH-2	CHRONAMITE MOD.# SR-40	ELECTRIC WATER HEATER (POINT-OF-USE) - 2P-50 AMP - 3600 WATTS	7.
EM-SREW	HANS / MOD. 8334NC	EMERGENCY: SHOWER AND EYE WASH	
HB	WOODFORD / 24 - INTERIOR	INTERIOR HOSE BIBB	
FP-YH	WOODFORD / U200 - EXTERIOR	EXTERIOR "FREEZELESS" - YARD HYDRANT	
WS	KINETICO / MOD. CP 216	WATER SOFTENER	
P.T.	WELL-RITE / MOD.#WR-100	PRESSURE TANK - WELL DIAPHRAGM	4.
FD	JR SMITH / MOD.#10415	FLOOR DRAIN WITH CLEAN OUT	

### NOTES:

1. INSTALL ELONGATED OPEN FRONT TOILET SEAT: TOTO MOD. SC534 OR APPROVED EQUAL.
2. INSTALL FAUCETS & WRIST BLADE HANDLES AMERICAN STANDARD MOD. #5501170 OR APPROVED EQUAL.
3. INSTALL FAUCETS WITH 5" WRIST BLADE HANDLES ELKAY MOD. LK-232-S-BH-5 WITH H&G WATER HOLES @ 8" ON CENTER
4. CONNECT WITH ONE INCH (1") BLUE POLY PIPE.
5. SUPPLY DEEP SINK W/ WRIST BLADE HANDLES AMERICAN STANDARD MOD. 8345101 OR APPROVED EQUAL.
6. RESTROOM WATER HEATER TEMPERATURE SHALL BE PRE-SET TO 110 F. WITH MIN. #8 WIRE.
7. UTILITY/MOP SINK WATER HEATER TEMPERATURE SHALL BE PRE-SET TO 120 F. WITH MIN. #8 WIRE.

### PLUMBING NOTES:

1. ALL WORK SHALL CONFORM TO APPLICABLE STANDARDS INCLUDING THE LATEST EDITION OF THE INDIANA MECHANICAL CODE AND THE INDIANA PLUMBING CODE.
2. ALL PIPING MATERIAL (WATER, DRAINAGE, VENT AND GAS) SHALL CONFORM TO THE ASTM STANDARDS REQUIRED BY THE CODE AND LIMITED TO THE MATERIALS APPROVED IN THE SPECIFICATIONS.
3. ALL PIPING JOINTS AND CONNECTIONS SHALL CONFORM TO THE MANDATORY REFERENCED STANDARDS LISTED IN THE LATEST EDITION OF THE INDIANA PLUMBING CODE.
4. ALL PIPING SHALL BE THOROUGHLY TESTED PRIOR TO BURIAL OR CONCEALMENT.
5. STERILIZE PIPING ACCORDING TO THE REQUIREMENTS OF THE INDIANA DEPARTMENT OF HEALTH.

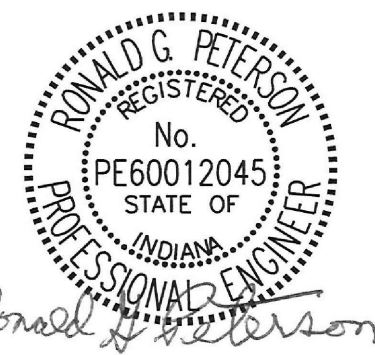

Certified by:

STORAGE BUILDING  
MORaine NATURE PRESERVE  
DEPT. OF NATURAL RESOURCES  
275 E. 650 N.  
VALPARAISO, INDIANA 46383



STATE OF INDIANA  
DEPARTMENT OF NATURAL RESOURCES  
DIVISION OF ENGINEERING  
ROOM 9099 INDIANA GOVERNMENT CENTER SOUTH  
402 WEST WASHINGTON STREET  
INDIANAPOLIS, INDIANA 46204  
TEL 317-232-4150, FAX 317-233-1205

Revisions:

Project Number: Project#	
Requisition Number: Requisition#	
Designer: RGP	Drawing Date: 9/13/17
Drafter: MAC	Drawing Scale: AS NOTED
DNR Approval:	
Client Approval:	
File Number: 400-071	
Drawing Number: P-2	
Sheet: 10	of 12